

SPECIFICATIONS

OUTDOOR

HOUSING

- Sealed Aluminum extrusion housing with lens
- White interior and cast aluminum end plates
- Available in 4' and 8' housings
- Socket bar, end plate, and ballast cover snap on easily

ELECTRICAL

- Quad Tap (QT) - 120-277V
- 0-10V Dimmable Driver standard
- Pf >.90
- THD<20%
- 4kV Surge Protection
- 50,000 hours @ L₇₀

OPTICAL SYSTEM

- Smooth, clear acrylic diffuser/lens
- Rotatable for specific light aiming
- Offered in 30K, 35K, 40K, 50K

MOUNTING

- Typically mounted on conduit
- End plate doubles as coupler when used in continuous run

CODE COMPLIANCE

- cULus Listed for Damp locations
- FCC Compliant
- RoHS Compliant
- BAA Compliant

WARRANTY

- 5 Year






LSLED2-K LED Linear Sign Light

ORDERING INFORMATION

MODEL#	Length x Wattage	Driver	Color
LSLED2-K	4FT	QT	30K
	4X17L (17W, 3220 Lumens)		35K
	4X24L (24W, 4480 Lumens)		40K
	4X30L (30W, 5705 Lumens)		50K
	4X37L (37W, 6910 Lumens)		
	4X48L (48W, 8640 Lumens)		
	4X70L (70W, 11,797 Lumens)		
	8FT		
	8X17L (17W, 3220 Lumens)		
	8X24L (24W, 4480 Lumens)		
	8X30L (30W, 5705 Lumens)		
	8X37L (37W, 6910 Lumens)		
	8X48L (48W, 8640 Lumens)		
	8X70L (70W, 11,797 Lumens)		
	8X74L (74W, 13,820 Lumens)		
	8X96L (96W, 17,280 Lumens)		
	8X140L (140W, 23,594 Lumens)		

OPTIONS (Factory Installed)

- | | |
|-----|------------------------|
| EM5 | - 5W Emergency Battery |
| CC | - Custom Color |

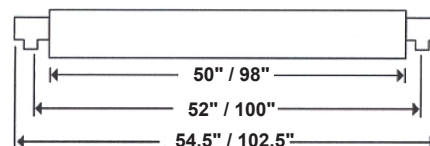


TYPICAL INSTALLATIONS

BUILDING MOUNTING

SADDLE STRAP ANCHORED TO COPING (BY OTHERS)


3/4" PIPE-CONDUIT MOUNTING ARM (BY OTHERS)

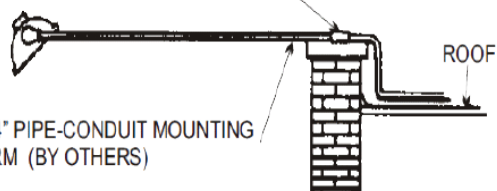

BUILDINGS

A natural for store-front and service station lighting. With this unit the store-front or service station is lighted uniformly from roof to grade.



BILLBOARD MOUNTING

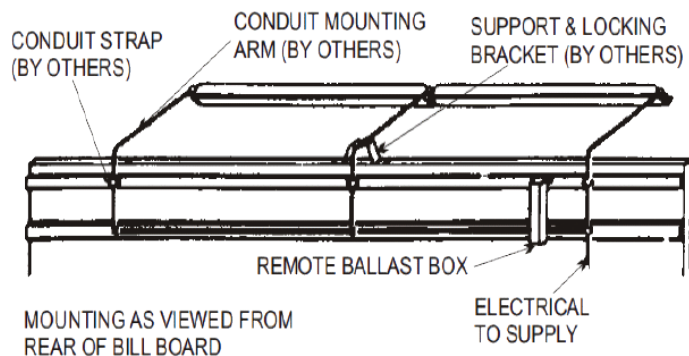

BILLBOARDS

Balanced high light output gives the advertising message greater impact. Copy and illustrations stand out and color distortion is virtually eliminated. Complete vertical surface is covered with a minimum of graduation and "hot spots" are eliminated.

LUMINAIRE SPACING AND MOUNTING

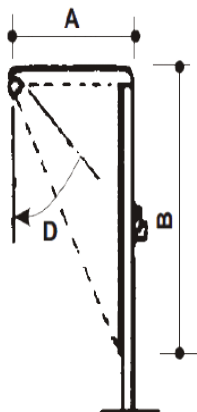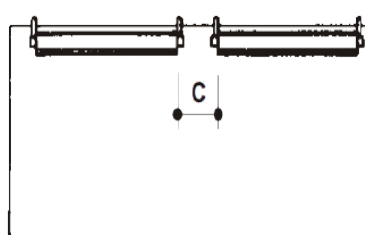

1. Dim. C should not exceed dimensions of A.
2. Dim. B should be twice the dimension of A.
3. If Dim. B exceeds 15 ft. then luminaires should be installed at top and bottom of area to be illuminated.
4. Angle of Dim. D should be 45° if dimensions are as outlined in paragraph No. 2. If Dim. A is four times less than Dim. B then angle should be 22.5°.

INDIVIDUAL



CONTINUOUS RUN

